


DOOR/FRAME SYSTEM INCLUDES SEAL SET 7 & CONTINUOUS HINGE:

- PEMKO SEALS: S776, S44 & 2009__PK THRESHOLD
- PEMKO CONTINUOUS HINGE: X25M__

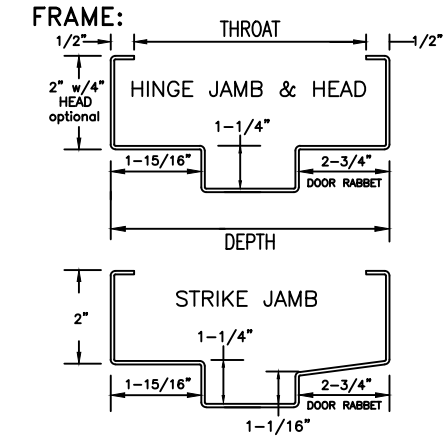

GAUGE & FINISH:


- 16 COLD ROLLED STEEL
- 16 GALVANNEALED

ANCHORS: MASONRY with SFA or EXISTING OPENING PIPE & PLATE
 CORNERS: CONTINUOUSLY WELDED

DOOR: GAUGE & FINISH:

- 18 COLD ROLLED STEEL
- 18 GALVANNEALED

EDGES
 VERTICAL: MECHANICALLY INTERLOCKED EDGES



TOP & BTM: INVERTED CHANNELS SEAMLESS

HDWE PREPS:
 CONTINUOUS HINGE:
 PEMKO X25MC OR X25MD

CYLINDRICAL LOCK:
 SARGENT 11 LINE (B or O ROSE)
 CORBIN-RUSSWIN CL3100 (C or K ROSE)

STRIKE: 4-7/8" ANSI A115.1 & A115.2

2 1/2" STC 55 Sound-Tech Xpress, Acoustical Door System

NOTES:
 MUTES ARE NOT ALLOWED. THE ONLY PREPS ALLOWED IN THE HEADER ARE SURFACE CLOSER REINFORCEMENTS. FRAME MUST BE GROUT FILLED. STC LABEL WILL BE APPLIED TO THE DOOR ONLY.
 • INDUSTRY STANDARD CONSTRUCTION TOLERANCES FOR SQUARENESS OF FRAME INSTALLATION, PLUMBNESS OF WALLS, FLATNESS OF FLOORS, FLANKING, ETC. MAY RESULT IN A DIFFERENCE OF 3dB - 5dB SOUND LOSS IN A FIELD TEST VERSUS LAB TEST.



ASSA ABLOY (Conversion: 1" = 25.4 mm, e.g., 1-3/4" = 44.45 mm)

DRAWN BY _____	DATE _____			
CHK'D BY _____	DATE _____			
SHT _____	CONTRACT NO. _____	ISSUE DATE _____	REVISIONS _____	BY _____

FOR HAND & SWING
 SEE DOOR SCHEDULE

FOR ANCHORAGE
 SEE DOOR SCHEDULE & ANCHOR SHEET



NOTE: FOR DESIGN, OR HDWE. REQUIRED, SEE DOOR AND HDWE. SCHEDULE.

FINISH: STANDARD PRIMER PAINT; TESTED IN CONFORMANCE WITH ANSI A250.10

ACOUSTICAL PERFORMANCE: DOOR SYSTEM TESTED IN CONFORMANCE WITH ASTM E2235, ASTM E1332, ASTM E90 & E413, FULLY OPERABLE, STC AS NOTED ABOVE. DOOR SYSTEMS ARE IN COMPLIANCE WITH HMMMA 865 & SDI-128 SPECIFICATIONS.