



DOUBLE SWING
ELEVATION



UL CLASSIFIED TO:
ICC 500(2014)
FEMA P-361 (2015)
FEMA P-320 (2014)

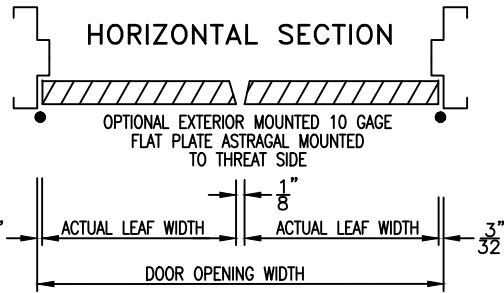

- 3/8" DOOR UNDERCUT
- 3/8" MAX. BETWEEN BOTTOM OF DOOR & TOP OF LOCK'S BOTTOM STRIKE

FIRE DOORS

DOORS MAY BE FIRE RATED UP TO AND INCLUDING 3 HOURS IN ACCORDANCE WITH UL 10B, UL10C, NFPA 252 & UL1784 IN HONEYCOMB CORE ONLY.

1-3/4" StormPro®

Tornado Resistant Door System (Double Swing)

With Corbin Russwin FE6600 or Sargent FM7300 Concealed Multi Point Lock

DESIGNED TO ENDURE TORNADO FORCE WINDS AND FLYING DEBRIS. DEVELOPED TO RESIST MISSILE PENETRATION FOR USE IN BUILDINGS DESIGNED AS SHELTERS OR SAFE ROOMS TO PROTECT OCCUPANTS FROM INJURY. SUCCESSFULLY TESTED AND COMPLIANT TO ICC 500-2014 STANDARD.



ASSA ABLOY

DRAWN BY _____ DATE _____		ISSUE DATE	REVISIONS	BY
CHKD BY _____ DATE _____				
SHT _____ OF _____	CONTRACT NO.			

ICC 500-2014
IMPACT: 15-LB. 2 X 4 MISSILE @ 100M.P.H.
DESIGN PRESSURE: +/- 284 PSF
TEST PRESSURE: +/- 341 PSF

INSWING & OUTSWING

SEE DOOR SCHEDULE FOR HAND

DOOR CONSTRUCTION/FEATURES

5'-4" x 6'-8" MIN. 8'-0" x 8'-0" MAX., 14 GA. CRS OR A60 GALVANNEALED STEEL FACE SHEETS WITH WELDED TOP AND BOTTOM CHANNELS, AND WELDED STEEL TOP CAP. EDGE SEAMS ARE FULLY WELDED FOR STRENGTH AND APPEARANCE. INSULATED CORE IS POLYSTYRENE WITH MIN. 0.7 PCF DENSITY. POLYURETHANE CORE THAT EXCEEDS 1.8 PCF DENSITY MAY BE USED AT FACTORY DISCRETION. FIRE RATED DOOR CORE WILL BE HONEYCOMB.

STORMPRO® HARDWARE PREPARATIONS


HINGES: 7'0" HEIGHTS & ABOVE (4) HINGES ARE REQUIRED WHEN USING BUTT HINGES. BELOW 7'0" HEIGHTS (3) HINGES ARE REQUIRED WHEN USING BUTT HINGES.

ACTIVE DOOR: REINFORCED AND PREPARED FOR CORBIN RUSSWIN FE6600 or SARGENT FM7300 CONCEALED MULTI POINT LOCK

INACTIVE DOOR: REINFORCED FOR CORBIN RUSSWIN 988CR, SARGENT 988, OR YALE 988Y SURFACE BOLTS

FRAME CONSTRUCTION/FEATURES

14 GAGE CRS OR HOT-DIPPED A60 GALVANNEALED STEEL

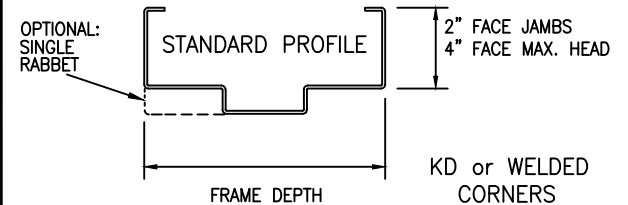

ANCHOR OPTIONS:

- MASONRY - "T" ANCHORS (12 GAGE)
- MASONRY - WIRE ANCHORS
- EXISTING OPENING ANCHORS W/ 6" BOLTS BY CECO
- WELD TO BUILDING STRUCTURE
- 3/8" SMS/SELF DRILLING SCREWS OR UNC BOLTS TO EMBEDMENT PLATE OR HOST STEEL STRUCTURE. FASTENERS BY OTHERS.
- POURED IN PLACE WALL

FRAMES ARE NOT REQUIRED TO BE GROUTED WHEN USING EXISTING WALL JAMB ANCHORS OR WHEN WELDED TO BUILDING STRUCTURE.

ANCHOR QUANTITY, LOCATION & GROUT REQUIREMENTS: REFERENCE WWW.CECODOOR.COM STORMPRO® INSTALLATION INSTRUCTIONS AND ANCHOR SUBMITTAL SHEETS.

(Conversion: 1" = 25.4 mm, e.g., 1-3/4" = 44.45 mm)